



Generated by COMcheck-Web Software

Interior Lighting Compliance Certificate

Section 1: Project Information

Energy Code: **2009 IECC**
Project Title: turbeville library
Project Type: New Construction

Construction Site:
Turbeville Library
Turbeville Library, South Carolina

Owner/Agent:
South Carolina

Designer/Contractor:
Dalton Simeone
200 regent park court
Greenville, South Carolina 29607
dsimeone@burdetteengr.com

Section 2: Interior Lighting and Power Calculation

A Area Category	B Floor Area (ft ²)	C Allowed Watts / ft ²	D Allowed Watts (B x C)
WHOLE LIBRARY (Library)	6900	1.3	8970
Total Allowed Watts =			8970

Section 3: Interior Lighting Fixture Schedule

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixtures	D Fixture Watt.	E (C X D)
WHOLE LIBRARY (Library, 6900 sq.ft.)				
FIXTURE IA: LED Linear 8W:	1	5	34	170
FIXTURE RB: LED A Lamp 25W:	1	6	19	114
FIXTURE TN: LED Panel 40W:	1	9	40	360
FIXTURE TZ: LED Panel 40W:	1	74	36	2664
FIXTURE WA: LED A Lamp 25W:	1	3	81	243
Total Proposed Watts =				3551

Section 4: Requirements Checklist

Interior Lighting PASSES: Design 60% better than code.

Lighting Wattage:

- ☒ 1. Total proposed watts must be less than or equal to total allowed watts.

Allowed Watts	Proposed Watts	Complies
8970	3551	YES

Controls, Switching, and Wiring:

- NA** ☐ 2. Daylight zones under skylights more than 15 feet from the perimeter have lighting controls separate from daylight zones adjacent to vertical fenestration.
- NA** ☐ 3. Daylight zones have individual lighting controls independent from that of the general area lighting.

Exceptions:

- ☐ Contiguous daylight zones spanning no more than two orientations are allowed to be controlled by a single controlling device.
- ☐ Daylight spaces enclosed by walls or ceiling height partitions and containing two or fewer light fixtures are not required to have a separate switch for general area lighting.

- ☒ 4. Independent controls for each space (switch/occupancy sensor).

Exceptions:

- ☒ Areas designated as security or emergency areas that must be continuously illuminated.
- ☐ Lighting in stairways or corridors that are elements of the means of egress.
- NA ☐ 5. Master switch at entry to hotel/motel guest room.
- NA ☐ 6. Individual dwelling units separately metered.
- NA ☐ 7. Medical task lighting or art/history display lighting claimed to be exempt from compliance has a control device independent of the control of the nonexempt lighting.
- ☒ 8. Each space required to have a manual control also allows for reducing the connected lighting load by at least 50 percent by either controlling all luminaires, dual switching of alternate rows of luminaires, alternate luminaires, or alternate lamps, switching the middle lamp luminaires independently of other lamps, or switching each luminaire or each lamp.

Exceptions:

- ☐ Only one luminaire in space.
- ☒ An occupant-sensing device controls the area.
- ☐ The area is a corridor, storeroom, restroom, public lobby or sleeping unit.
- ☒ Areas that use less than 0.6 Watts/sq.ft.
- ☒ 9. Automatic lighting shutoff control in buildings larger than 5,000 sq.ft.

Exceptions:

- ☐ Sleeping units, patient care areas; and spaces where automatic shutoff would endanger safety or security.
- ☒ 10. Photocell/astronomical time switch on exterior lights.

Exceptions:

- ☐ Lighting intended for 24 hour use.
- NA ☐ 11. Tandem wired one-lamp and three-lamp ballasted luminaires (No single-lamp ballasts).

Exceptions:

- ☐ Electronic high-frequency ballasts; Luminaires on emergency circuits or with no available pair.

Section 5: Compliance Statement

Compliance Statement: The proposed lighting design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed lighting system has been designed to meet the 2009 IECC requirements in COMcheck-Web and to comply with the mandatory requirements in the Requirements Checklist.



Larry C. Mahaffey, P.E.

Name - Title

Signature

8/29/25

Date

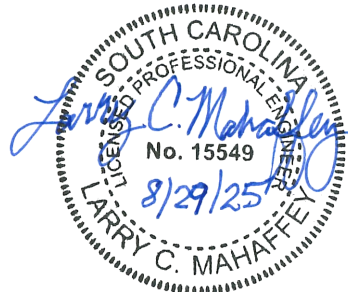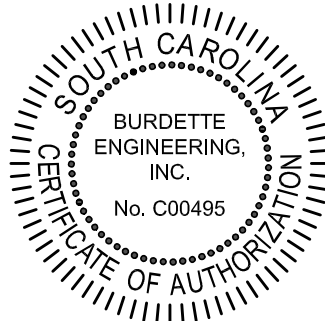



Generated by COMcheck-Web Software

Exterior Lighting Compliance Certificate

Section 1: Project Information

Energy Code: **2009 IECC**

Project Title:

Project Type: New Construction

Exterior Lighting Zone: 2 (Neighborhood business district (LZ2))

Construction Site:

Turbeville Library

Turbeville Library, South Carolina

Owner/Agent:

South Carolina

Designer/Contractor:

Dalton Simeone

200 regent park court

Greenville, South Carolina 29607

dsimeone@burdetteengr.com

Section 2: Exterior Lighting Area/Surface Power Calculation

A Exterior Area/Surface	B Quantity	C Allowed Watts / Unit	D Tradable Wattage	E Allowed Watts (B x C)	F Proposed Watts
Walkway < 10 feet wide	950 ft of walkway length	0.7	Yes	665	684
Main entry	40 ft of door width	20	Yes	800	174
Other door (not main entry)	12 ft of door width	20	Yes	240	54
Total Tradable Watts* =				1705	912
Total Allowed Watts =				1705	
Total Allowed Supplemental Watts** =				600	

* Wattage tradeoffs are only allowed between tradable areas/surfaces.

** A supplemental allowance equal to 600 watts may be applied toward compliance of both non-tradable and tradable areas/surfaces.

Section 3: Exterior Lighting Fixture Schedule

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixtures	D Fixture Watt.	E (C X D)
Walkway < 10 feet wide (950 ft of walkway length): Tradable Wattage				
FIXTURE M1: LED A Lamp 12W:	1	12	57	684
Main entry (40 ft of door width): Tradable Wattage				
FIXTURE PA: LED Other Fixture Unit 25W:	1	1	50	50
FIXTURE RLE: LED Other Fixture Unit 28W:	1	2	40	80
FIXTURE WS: LED Other Fixture Unit 25W:	1	2	22	44
Other door (not main entry) (12 ft of door width): Tradable Wattage				
FIXTURE RAE: LED A Lamp 2.5W:	1	2	27	54
Total Tradable Proposed Watts =				912

Section 4: Requirements Checklist

Lighting Wattage:

- ☒ 1. Within each non-tradable area/surface, total proposed watts must be less than or equal to total allowed watts. Across all tradable areas/surfaces, total proposed watts must be less than or equal to total allowed watts.

Compliance: Passes.

Controls, Switching, and Wiring:

- ☒ 2. All exemption claims are associated with fixtures that have a control device independent of the control of the nonexempt lighting.
- ☒ 3. Lighting not designated for dusk-to-dawn operation is controlled by either a photosensor (with time switch), or an astronomical time switch.
- ☒ 4. Lighting designated for dusk-to-dawn operation is controlled by an astronomical time switch or photosensor.
- ☒ 5. All time switches are capable of retaining programming and the time setting during loss of power for a period of at least 10 hours.

Exterior Lighting Efficacy:

- N/A ☐ 6. All exterior building grounds luminaires that operate at greater than 100W have minimum efficacy of 60 lumen/watt.

Exceptions:

- ☐ Lighting that has been claimed as exempt and is identified as such in Section 3 table above.
- ☐ Lighting that is specifically designated as required by a health or life safety statute, ordinance, or regulation.
- ☐ Emergency lighting that is automatically off during normal building operation.
- ☐ Lighting that is controlled by motion sensor.

Exterior Lighting PASSES: Design 60% better than code.

Section 5: Compliance Statement

Compliance Statement: The proposed exterior lighting design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed lighting system has been designed to meet the 2009 IECC requirements in COMcheck-Web and to comply with the mandatory requirements in the Requirements Checklist.

Larry C. Mahaffey, P.E.

Name - Title

Signature

8/29/25

Date

